



Level



Pressure



Flow



Temperature



Liquid
Analysis



Registration



Systems
Components



Services



Solutions

Technical Information

Rod probe 11375Z

Conductive level limit detection

Partially insulated rod probe for use in conductive liquids



Application

- Conductive level limit detection in process or storage tanks for all kinds of liquids:
 - for conductivity as of 0.02 mS/cm
 - for temperatures from –40 °C to 200 °C
 - for pressures up to 50 bar
- As overflow protection with line monitoring even in Ex-area Zone 0
- For minimum or maximum detection in tanks
- As pump protection in pipes
- Can be used for two-point control

Your benefits

- Cooling adapter for higher fluid temperatures, as of 100 °C
- Subsequent probe length shortening possible
- WHG (German Water Resources Act) + ATEX II 1/2 G approval
- Can be connected to separate switching units FTW325, FTW470Z, FTW570Z
- Safety thanks to line monitoring
- Long operating life and reliable function without wear since no moving parts in the tank
- Cost-effective probe for conductive liquid

Table of contents

Function and system design	3
Measuring principle	3
Measuring system	3
Input	3
Measured variable	3
Measuring range (detection range)	3
Input signal	3
Output	4
Switching units	4
Output signal	4
Line monitoring	4
Power supply	4
Electrical connection	4
Cable entry	5
Cable specifications	5
Installation	5
Installation instructions	5
Shortening probe rod	6
Mounting in piping	6
Environment	6
Ambient temperature range	6
Storage temperature	6
Degree of protection	6
Electromagnetic compatibility	6
Process	7
Medium temperature range	7
Conductivity	7
Process material pressure limits	8
Mechanical construction	8
Design, dimensions	8
Weight	9
Wetted materials	9
Fitted electrodes	9
Certificates and approvals	9
CE mark	9
Overfill protection	9
Type of protection	9
Ordering information	10
Rod probe 11375Z	10
Supplementary documentation	11
Technical Information	11
Operating Instructions	11
Certificates	11

Function and system design

Measuring principle


Alternating voltage is supplied to the probe by means of a transmitter (e.g. Nivotester FTW325). As soon as the conductive liquid forms a connection to the partition and the sensor, a measurable current flows which causes the sensor to switch. The use of alternating voltage prevents corrosion on the probe rod and electrolytic corrosion of the medium.

Measuring system

11375Z probe in the liquid tank, Nivotester FTW level limit switch in the control room

The measuring system consists of:

- At least one 11375Z probe
- A switching unit (e.g. FTW325 or FTW470Z, FTW570Z)
- Controllers, switch transmitters or signal transmitters, e.g. process control systems PLC, relays etc.

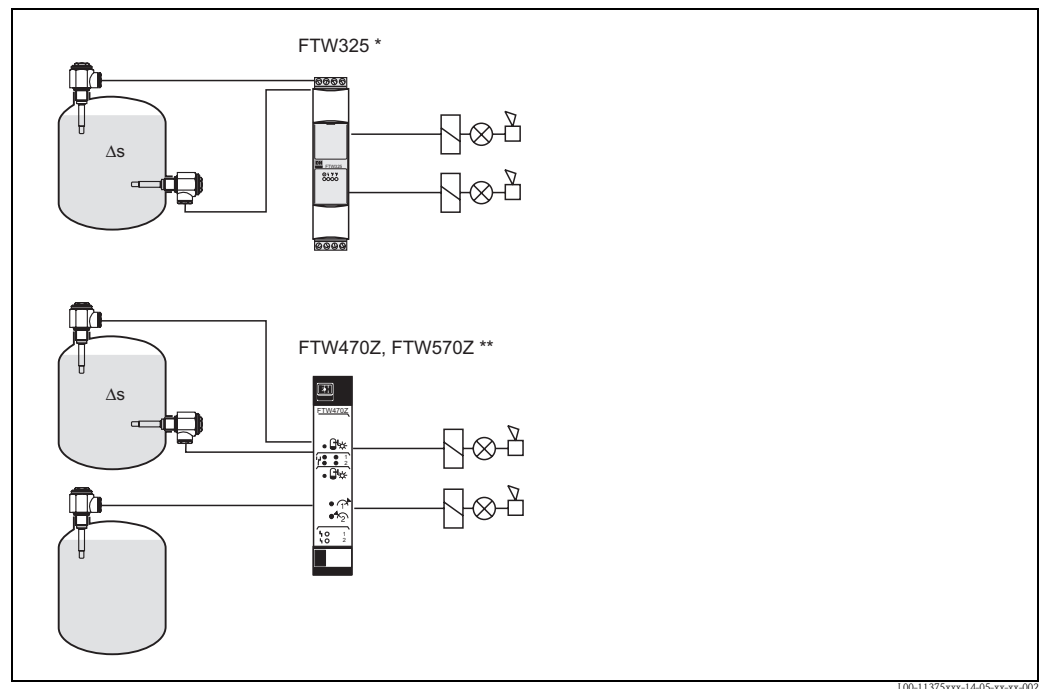

* For two independent level limits or a two-point control (Δs)

** For two independent level limits or two two-point controls independent of one another (Δs) or one level limit and one two-point control (Δs)

FTW470Z/570Z: Phase-out 2006

Input

Measured variable

Change in resistance between tank wall and probe rod caused by presence/absence of conductive product (limit value, binary).

Measuring range (detection range)

The measuring range depends on the probe mounting location. The probes can be max. 2000 mm long.

Input signal

Probe covered => A measurable current flows between the probe rod and tank wall
 Probe not covered => A measurable current does not flow between the probe rod and tank wall

Output

Switching units

Nivotester FTW325, FTW470Z*, FTW570Z*

Phase-out: 2006

Output signal

Relay output with floating change-over contacts for level alarms;
For more information, see Nivotester FTW325, FTW470Z, FTW570Z; Technical Information

Line monitoring

An additional printed circuit board for line monitoring is installed in the housing for probes with WHG approval. It is always switched or connected between the rod and housing wall.




Note!

It has to be removed if using switching units (transmitters) that do not support line monitoring.

Power supply

Electrical connection

Standard + ATEX: 2 terminals for core cross-section to 2.5 mm² in housing
With line monitoring: 2 m captive cable

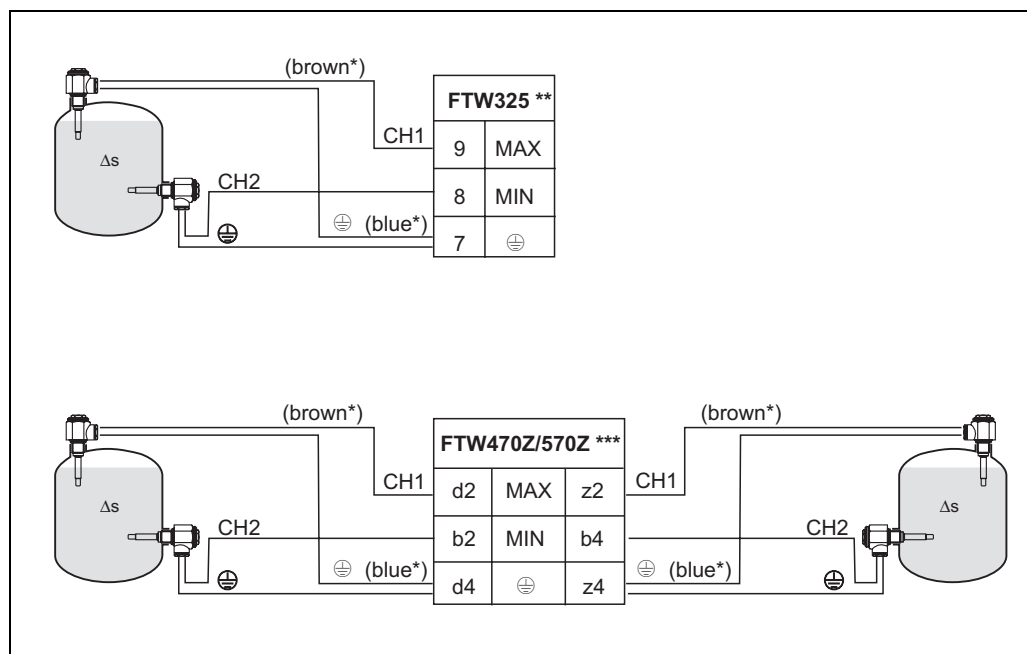

L00-11375Zxx-04-05-xx-es-003

* With line monitoring

** For two independent level limits or a two-point control (Δs)

*** For two independent level limits or two two-point controls independent of one another (Δs)
or one level limit and one two-point control (Δs)

FTW470Z/570Z: Phase-out 2006

Cable entry

The cable gland PG16 is suitable for cable diameters from 7 mm to 12 mm.
 The terminals in the housing are designed for strands up to 2.5 mm² in wire end ferrules
 – central terminal for the probe rod,
 – lateral terminal for earth connection.



Note!
 A 2 m captive twin-core cable is supplied for line monitoring.

Cable specifications

Use usual commercial cable (25 Ω per core).
 The connecting cable must comply with the requirements at the place of deployment.
 Use a screened cable in the event of strong electromagnetic influence.

Operating conditions

Installation

Installation instructions


Mounting location

The orientation is preferably vertical from above. In the case of lateral mounting, mount the probes with the tip of the probe pointing slightly downwards.

Use cooling adapter for fluid temperatures as of 100 °C.

Orientation

Level limit detection for standard applications in metal tanks.

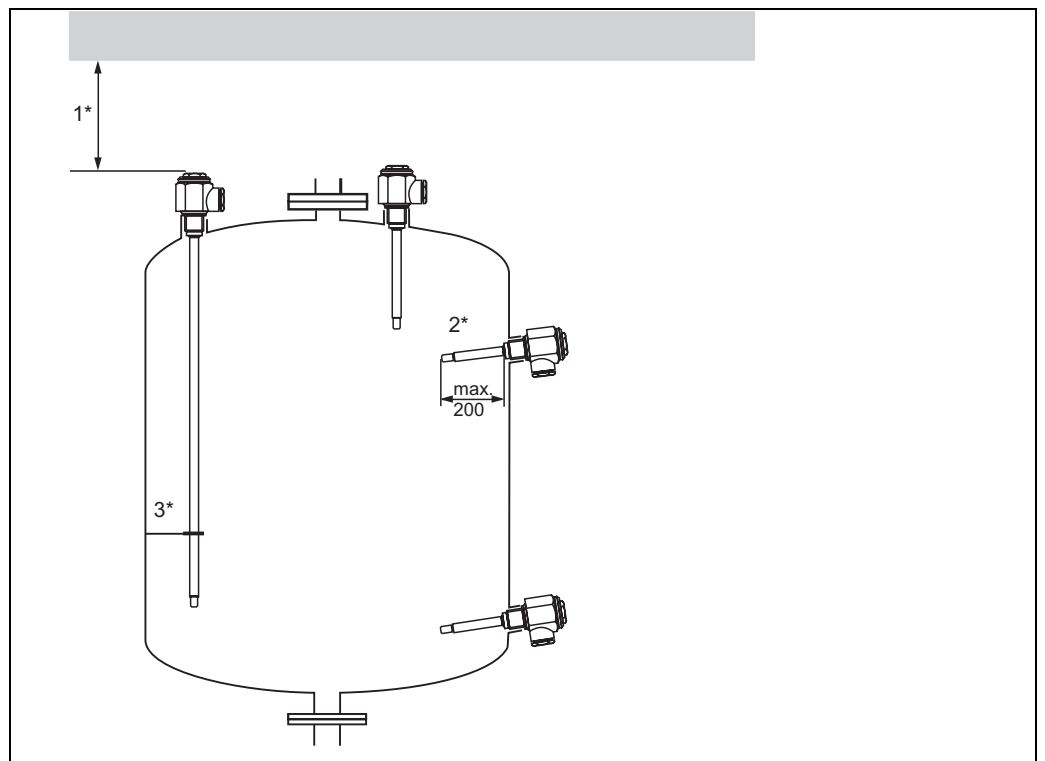


- 1* Sufficient clearance provided outside the tank so the probe can be inserted without the application of force.
- 2* A short probe (maximum length 200 mm) can also be installed laterally, preferably with the tip of the probe pointing slightly downwards, so that the liquid can drain off better and conductive build-up does not form.
- 3* If used in agitated liquids, probes over 1 m in length must be laterally supported by insulated brackets.

Shortening probe rod

The probe can be shortened to any length.

Note!

- Do not damage the insulation at any other point
- After shortening, remove insulation over at least 20 mm at the tip of the probe
- No mechanical strain may be put on the probe when shortening the probe rod

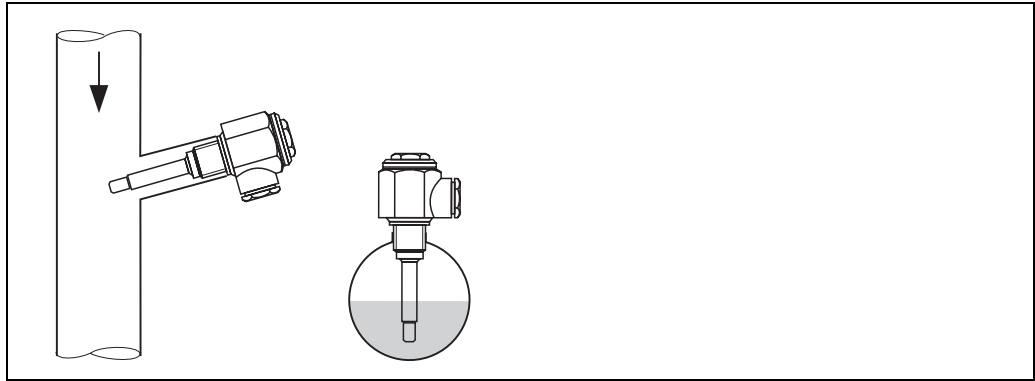Mounting in piping

L00-11375Zxx-11-05-xx-xx-001

Environment

Ambient temperature range

Depends on the fluid temperature (limited through permitted interior temperatures of the connection housing)

Permitted interior temperatures of the connection housing:

Standard: $-40\text{ °C} \dots +200\text{ °C}$, depends on the connecting cable and seal in the cable gland

ATEX: $-40\text{ °C} \dots +135\text{ °C}$, depends on the connecting cable and seal in the cable gland

WHG: $-20\text{ °C} \dots +65\text{ °C}$ (with line monitoring)

Storage temperature

$-40\text{ °C} \dots +80\text{ °C}$

$-20\text{ °C} \dots +65\text{ °C}$ (with line monitoring)

Degree of protection

IP55 as per EN 60529

Electromagnetic compatibility


For interference emission and interference immunity, see connected Nivotester FTW limit switch
EMC test procedures, see TI241F/00/en

Process

Medium temperature range


Standard: -40 °C...+200 °C
 ATEX: -40 °C...+135 °C (depending on temperature class)
 WHG: -20 °C...+ 65 °C (with line monitoring)

Connection between fluid temperature and interior temperature of the connection housing depending on ambient temperature and cooling adapter:

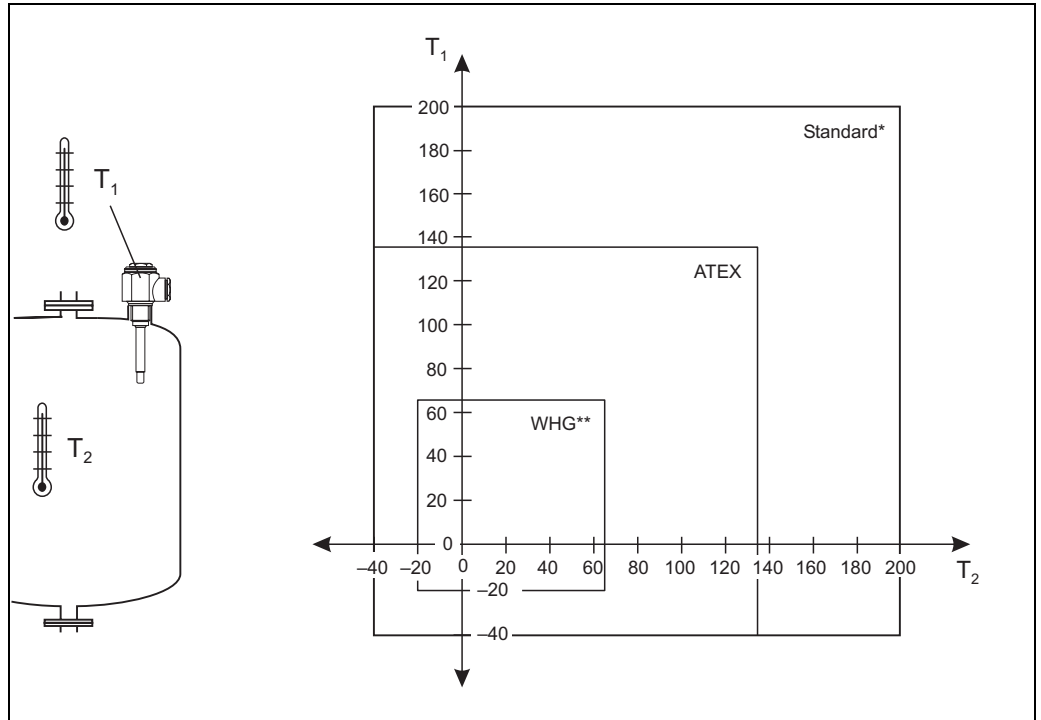

L00-11375Zxx-05-xx-xx-001

* With cooling adapter
 ** With line monitoring

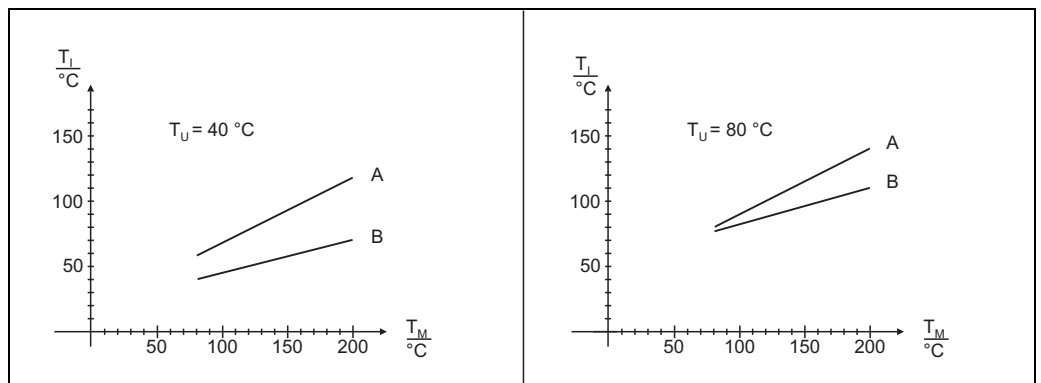

L00-11375Zxx-05-xx-xx-001


A = Without cooling adapter
 B = With cooling adapter
 T_I = Interior temperature of the housing
 T_M = Medium temperature
 T_U = Ambient temperature

Conductivity

Min. 0.02 mS/cm, see limit switch connected

Process material pressure limits

Standard: Line pressure p_e -1 bar...+50 bar, see graphic
 ATEX + WHG: Note explosion protection directives and information in the certificates

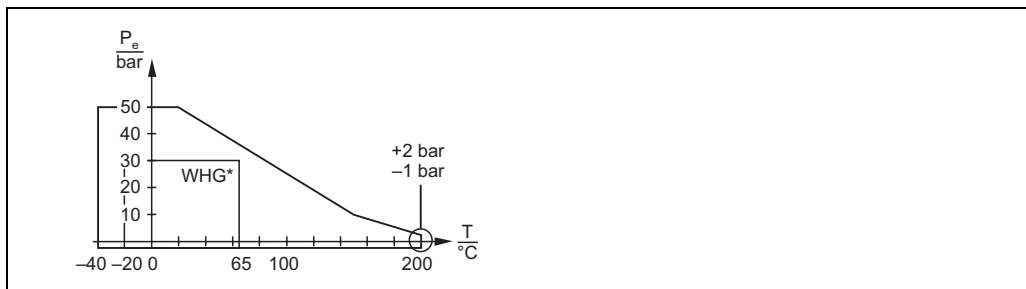

L00-11375Zxx-05-05-xx-xx-002


* With line monitoring

Mechanical construction



Note!
 All dimensions in mm

Design, dimensions

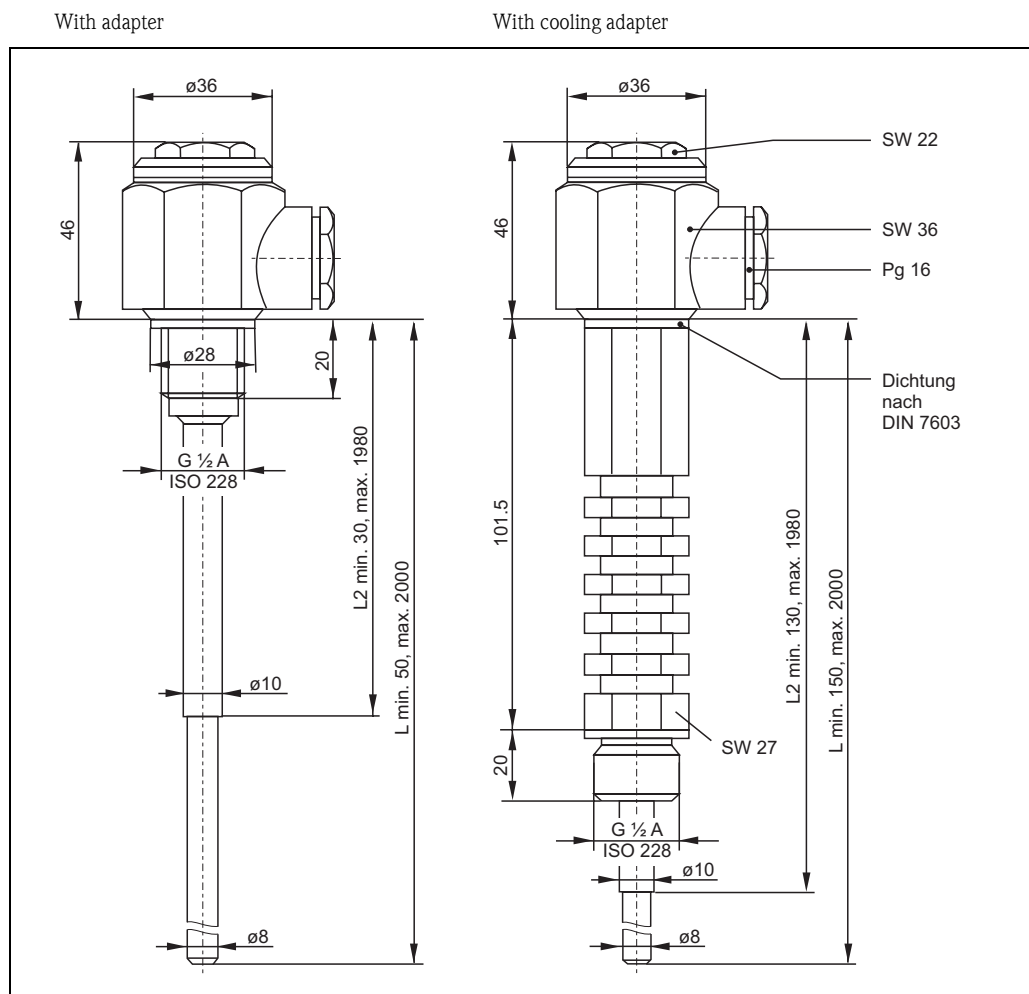

L00-11375Zxx-06-05-xx-xx-001



Note!
 Length of partial insulation min. 20 mm shorter than the probe length.
 Please indicate the desired probe length in mm when ordering.

Weight	Rod 1 m in length 500 g
Wetted materials	Probe rod Corrosion-resistant steel 316Ti (1.4571) Process connections Corrosion-resistant steel 316Ti (1.4571) Partial insulation PTFE Seal Copper Cooling adapter Corrosion-resistant steel 316Ti (1.4571)

Fitted electrodes	Rod probe <ul style="list-style-type: none">■ Diameter without insulation: 4 mm■ Maximum rod length: 2000 mm■ Minimum rod length: 50 mm■ Insulation thickness: 0.5 mm■ Length of non-insulated area (tip of rod): 20 mm
--------------------------	--

Certificates and approvals

CE mark	The device is in conformity with the statutory requirements of the EC Directives. Endress+Hauser confirms that the device has been tested successfully by applying the CE mark.
Overfill protection	WHG (German Water Resources Act)
Type of protection	Conductive <ul style="list-style-type: none">■ EC type-examination certificate TÜV 02 ATEX 1951 X

Ordering information

Rod probe 11375Z

10	Approval	
P	ATEX II 1/2 G EEx ia IIC T6	
Q	ATEX II 1/2 G EEx ia IIC T6, WHG	
R	Non-hazardous area	
S	Non-hazardous area, WHG	
Y	Special version	
20	Application	
X	Non-specified switching unit	
Y	Special version	
30	Process connection, material	
G1	Thread ISO228 G 1/2 A, 316Ti	
K1	Thread ISO228 G 1/2 A, 316Ti + cooling adapter	
Y9	Special version	
40	Partial insulation material	
A	PTFE	
Y	Special version	
50	Length of partial insulation L2	
1 mm	L2
2	230 mm	L2 (standard)
5 inch	L2
6	9 inch	L2
9	Special version	
60	Rod material	
A	Rod 316Ti	
Y	Special version	
70	Length of probe L	
1 mm	L
2	250 mm	L, can be shortened
3	500 mm	L, can be shortened
4	1,000 mm	L, can be shortened
5 inch	L
6	10 inch	L, can be shortened
7	20 inch	L, can be shortened
8	39 inch	L, can be shortened
9	Special version	
995	Marking	
1	Tagging (TAG)	
11375Z	Product designation	



Note!

Cooling adapter for higher medium temperatures up to +200 °C only for use in non-hazardous areas (R).

Supplementary documentation

Technical Information

- Nivotester FTW325
TI373F/00/EN
-

Operating Instructions

- Rod probe 11375Z
KA240F/00/A6
 - Nivotester FTW325
KA199F/00/A6
-

Certificates

General construction supervision approval

- Conductive level limit detection
ZE043F/00/DE

Safety instructions (ATEX)

- Conductive level limit detection
XA197F/00/A3

Instruments International

Endress+Hauser
Instruments International AG
Kaegenstrasse 2
4153 Reinach
Switzerland

Tel. +41 61 715 81 00
Fax +41 61 715 25 00
www.endress.com
info@ii.endress.com

Endress+Hauser 

People for Process Automation

TI298F/00/EN/05.10
71115354
CCS/FM+SGML 6.0



71115354